


Maximum Sized Rescue or Escape Windows From Sleeping Rooms



Emergency escape and rescue opening required. Basements, habitable attics, and every sleeping room shall have not less than one operable emergency escape and rescue opening. Where basements contain one or more sleeping rooms, an emergency escape and rescue opening shall be required in each sleeping room. Emergency escape and rescue openings shall open directly into a public way, or to a yard or court that opens to the public way.

Minimum opening area. The minimum net clear openings for emergency escape and rescue grade floor or below grade openings shall be 4.6 square feet.

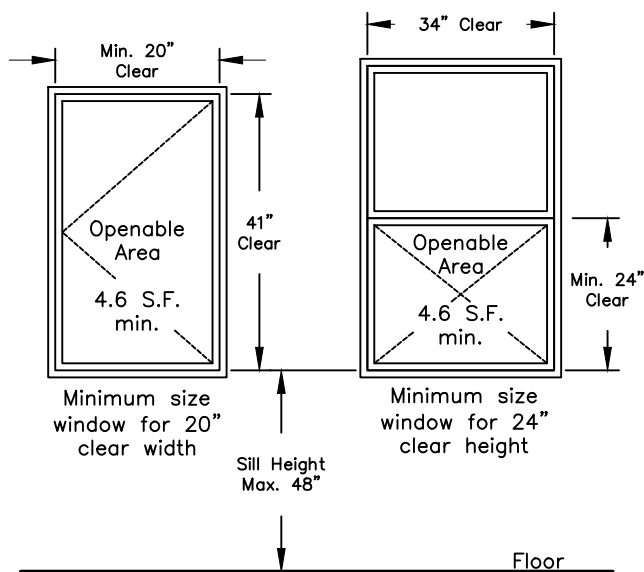