


IDENTIFICATION OF SAFETY GLAZING Permanent label required on each window. The glass designation shall be acid etched, sand-blasted, ceramic-fired, laser etched, embossed, or be of a type which once applied cannot be removed without glass being destroyed (R308.1).

SAFETY GLAZING ADJACENT DOORS (R308.4.2)

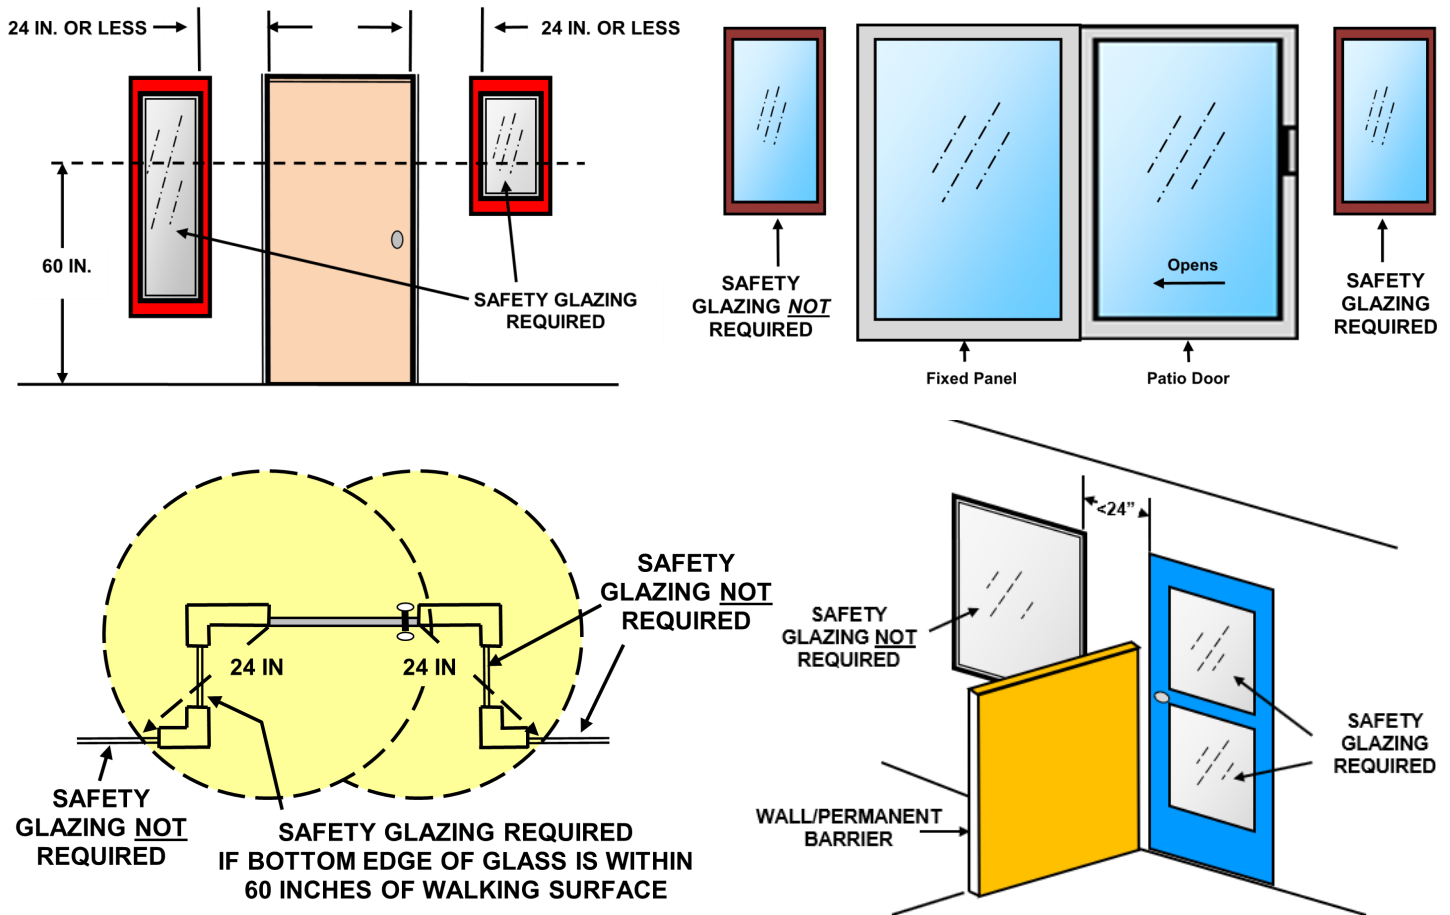


Safety Glazing is NOT required in walls perpendicular to the door on the latch side of the door (R308.4.2).

Safety Glazing is NOT required adjacent a door if there is a wall or other permanent barrier between the door and the glazing.
(R308.4.2 Exception 2)


SAFETY GLAZING IN WINDOWS (R308.4.3)

SAFETY GLAZING REQUIRED ONLY IF ALL FOUR CRITERIA EXIST

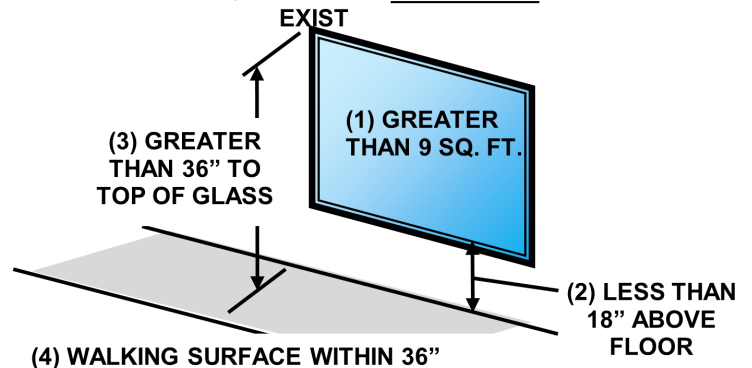

SAFETY GLAZING ADJACENT STAIRS, RAMPS AND LANDINGS


(R308.4.6 & R308.4.7)

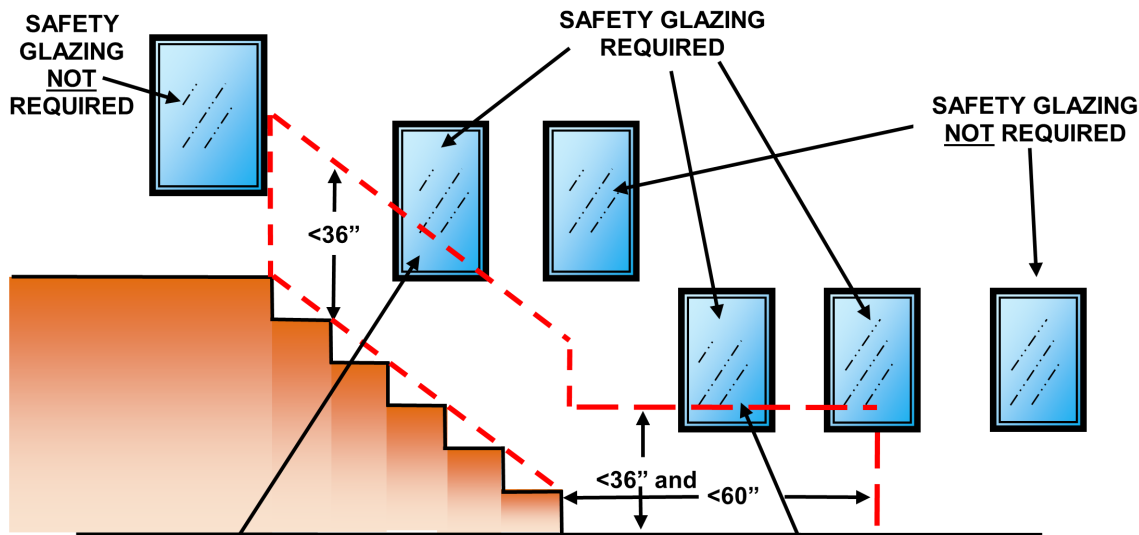

Glazing not required when a horizontal rail is installed at 34" to 38" above the walking surface. The rail shall withstand a horizontal load of 50 pounds per linear foot without contacting the glass and have a cross-sectional height of not less than 1 1/2 inches. (R308.4.6 Exception 1)

Glazing adjacent to the bottom stair landing not required when protected by a guard complying with Section R312 and the plane of the glass is more than 18 inches from the guard. (R308.4.7 Exception)

SAFETY GLAZING IN GUARDS AND RAILINGS Glazing in guards and railings, including structural baluster panels and nonstructural in-fill panels, regardless of area or height above a walking surface shall be considered a hazardous location (R308.4.4).

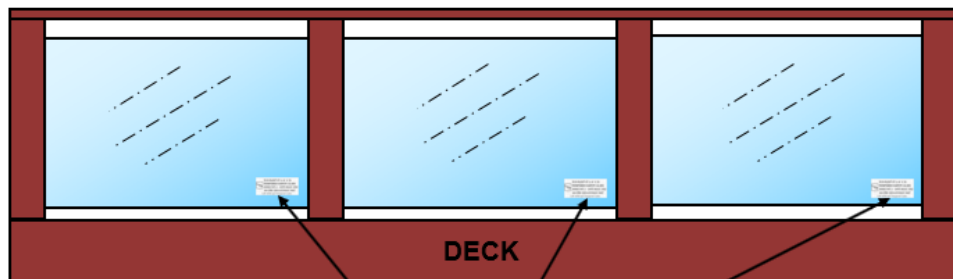

Permanent label required on each panel

(Label shall be of a type which once applied cannot be removed without glass being destroyed)

SAFETY GLAZING REQUIRED ADJACENT WET SURFACES (R308.4.5)

